


- PIN
1. BLK(W8601) PUMP CONTROL
  2. BLK(W5000) ROOM 1 EXTEND
  3. BLK(W5100) ROOM 1 RETRACT
  4. BLK(W5001) ROOM 2 EXTEND
  5. BLK(W5101) ROOM 2 RETRACT
  6. RED(W6125) BATTERY
  7. RED(W6125) BATTERY
  8. N/C
  9. N/C

- PIN
1. BLK(W8601) PUMP CONTROL
  2. BLK(W5000) EXTEND
  3. BLK(W5100) RETRACT
  4. N/C
  5. N/C
  6. RED(W6125) BATTERY

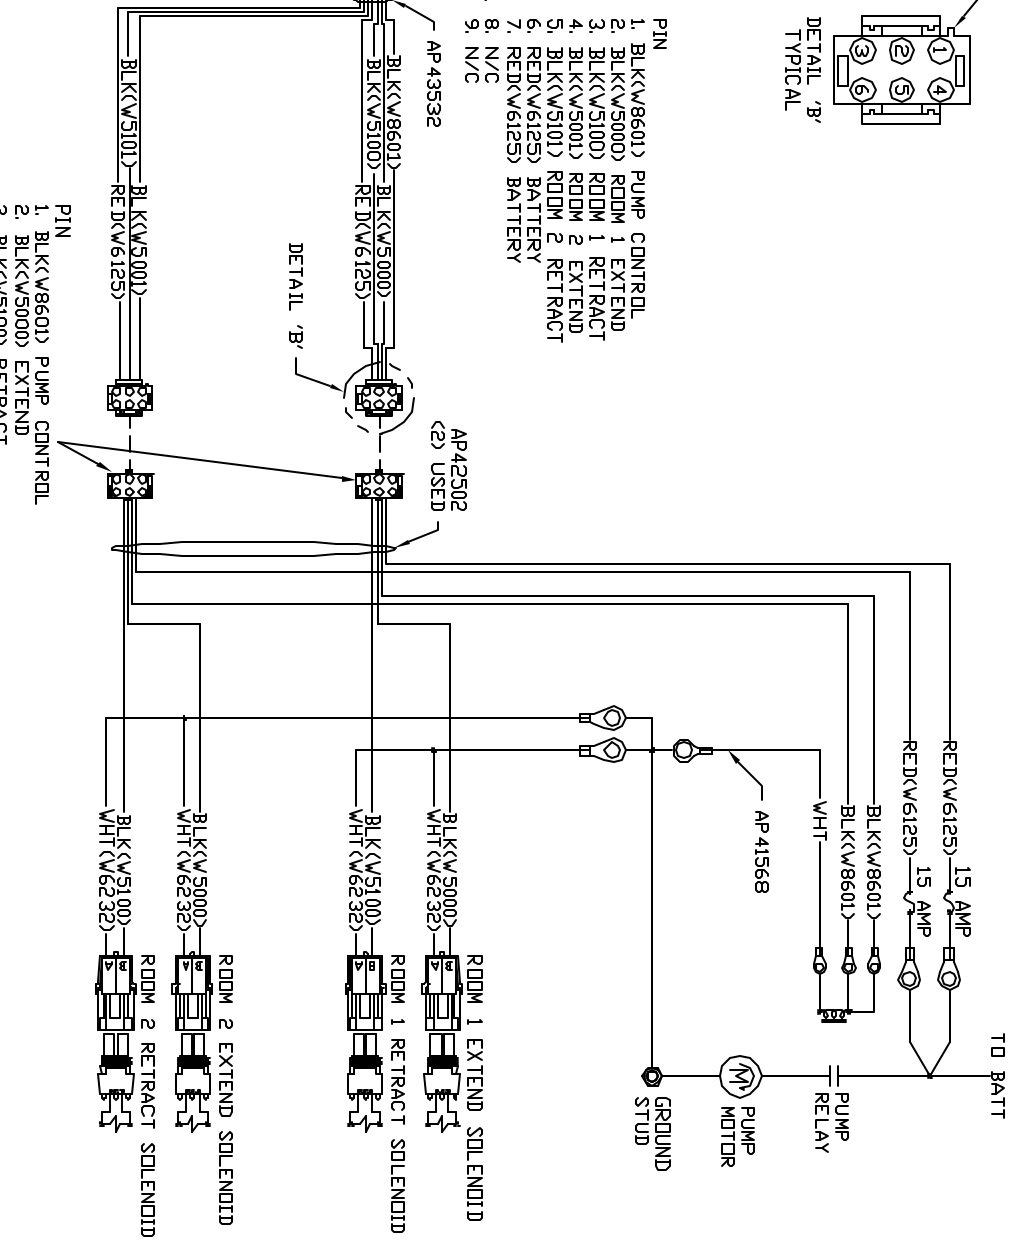

NOTE: INSTALLATION MUST CONFORM TO GOOD SHOP PRACTICES, SAE STANDARDS, RVIA STANDARDS, AND OTHER APPLICABLE STANDARDS.

NO.	DATE	REVISION

<p>THE INFORMATION DISCLOSED IN THIS DRAWING IS CONFIDENTIAL AND MUST NOT BE DISCLOSED OR USED IN ANY MANNER WHICH WILL BE DETRIMENTAL TO THE HWH CORPORATION</p>	<p>DRAWING NUMBER MP908710</p>
---	------------------------------------

<p>SCALE 1:3 DATE 04 JUN 13 DRAWN BY</p>	<p>SYSTEM SCHEMATIC ELEC</p>
--	------------------------------

<p>HWH 1-80 EXT 267 SOUTH RT 1 MOSCOW, IOWA 52760</p>
---